

STORY	OCCUPANCY	MAXIMUM OCCUPANTS (OR DWELLING UNITS) PER FLOOR AND TRAVEL DISTANCE
First story or basement	A, B ^d , E ^e , F ^d , M, U, S ^d	49 occupants and 75 feet travel distance
	H-2, H-3	3 occupants and 25 feet travel distance
	H-4, H-5, I, R	10 occupants and 75 feet travel distance
Second story	S ^a	29 occupants and 100 feet travel distance
	B ^b , F, M, S ^a	29 occupants and 75 feet travel distance
Third story	R-2	4 dwelling units and 50 feet travel distance
	R-2 ^c	4 dwelling units and 50 feet travel distance

For SI: 1 foot = 304.8 mm.

- For the required number of exits for parking structures, see Section 1021.1.2.
- For the required number of exits for air traffic control towers, see Section 412.3 of the *International Building Code*.
- Buildings classified as Group R-2 equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1 or 903.3.1.2 and provided with emergency escape and rescue openings in accordance with Section 1029.
- Group B, F and S occupancies in buildings equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1 shall have a maximum travel distance of 100 feet.
- Day care occupancies shall have a maximum occupant load of 10.

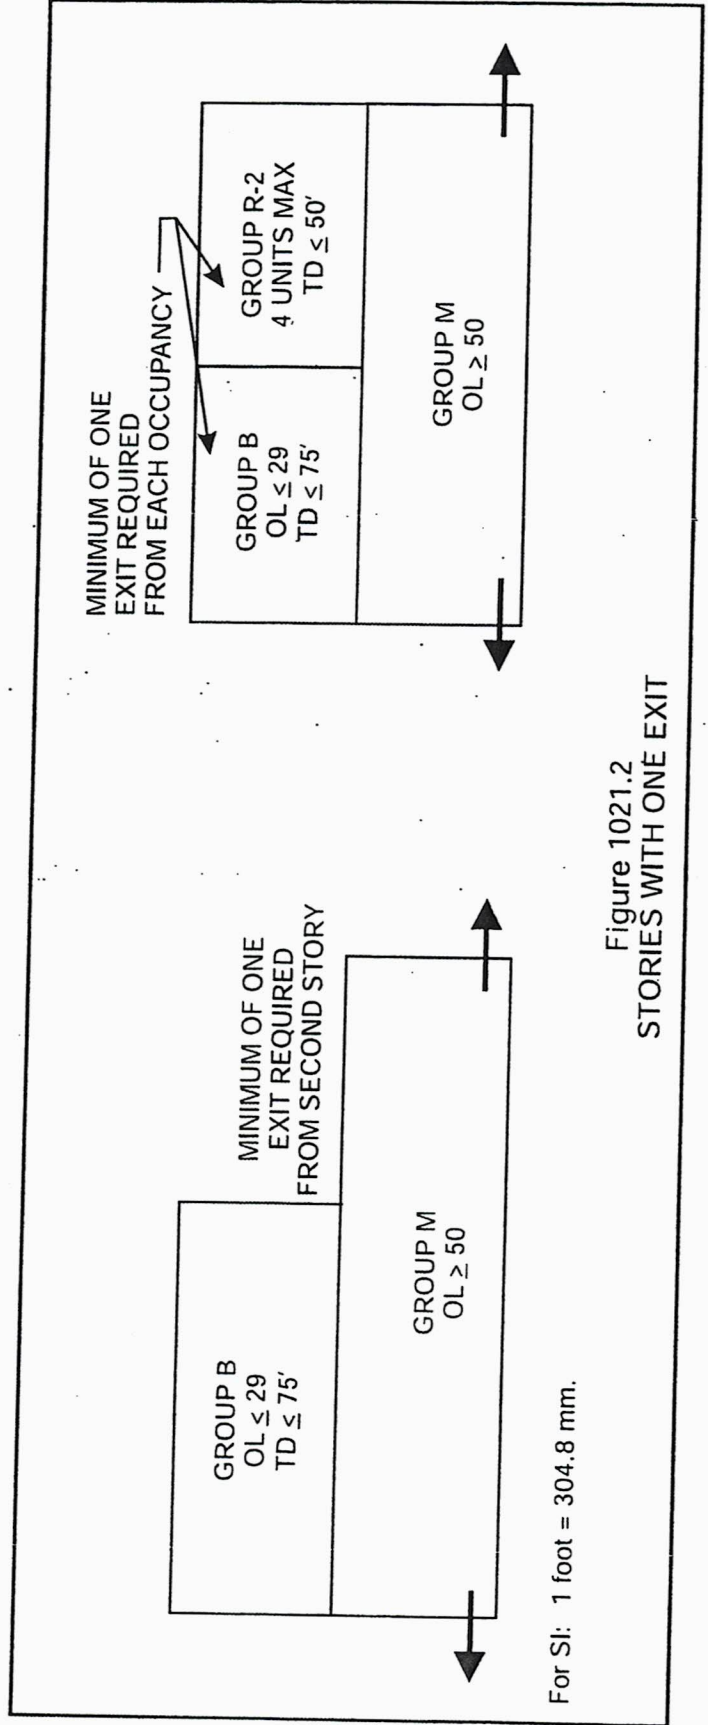


Figure 1021.2
STORIES WITH ONE EXIT